

CITY OF COMMERCE

ELIZABETH ST. FEEDER POLE REPLACEMENT 2020


LEGEND



NOTES:

- 1) TRANSFER OR REPLACE ALL ITEMS FROM OLD POLES TO NEW POLES.
- 2) SPECS ARE PER ELECTRIC CITIES SPEC BOOK.

UTILITIES PROTECTION CENTER, INC.
OF GEORGIA
CALL FREE THROUGHOUT GEORGIA
1-800-262-7411
(770) 623-4344 WINDY ATLANTA
OUT OF STATE CALL COLLECT (404) 325-5900
THREE WORKING DAYS BEFORE YOU GO
IT'S THE LAW
BEFORE ANY EXCAVATION WORK BEGINS OR ANY WORK BEGINS
WITHIN TEN(10) FT. OVERHEAD POWER LINES OF 250 VOLTS OR
MORE, NOTIFICATION MUST BE MADE TO THE UTILITIES PROTECTION
CENTER, INC. IT'S THE LAW

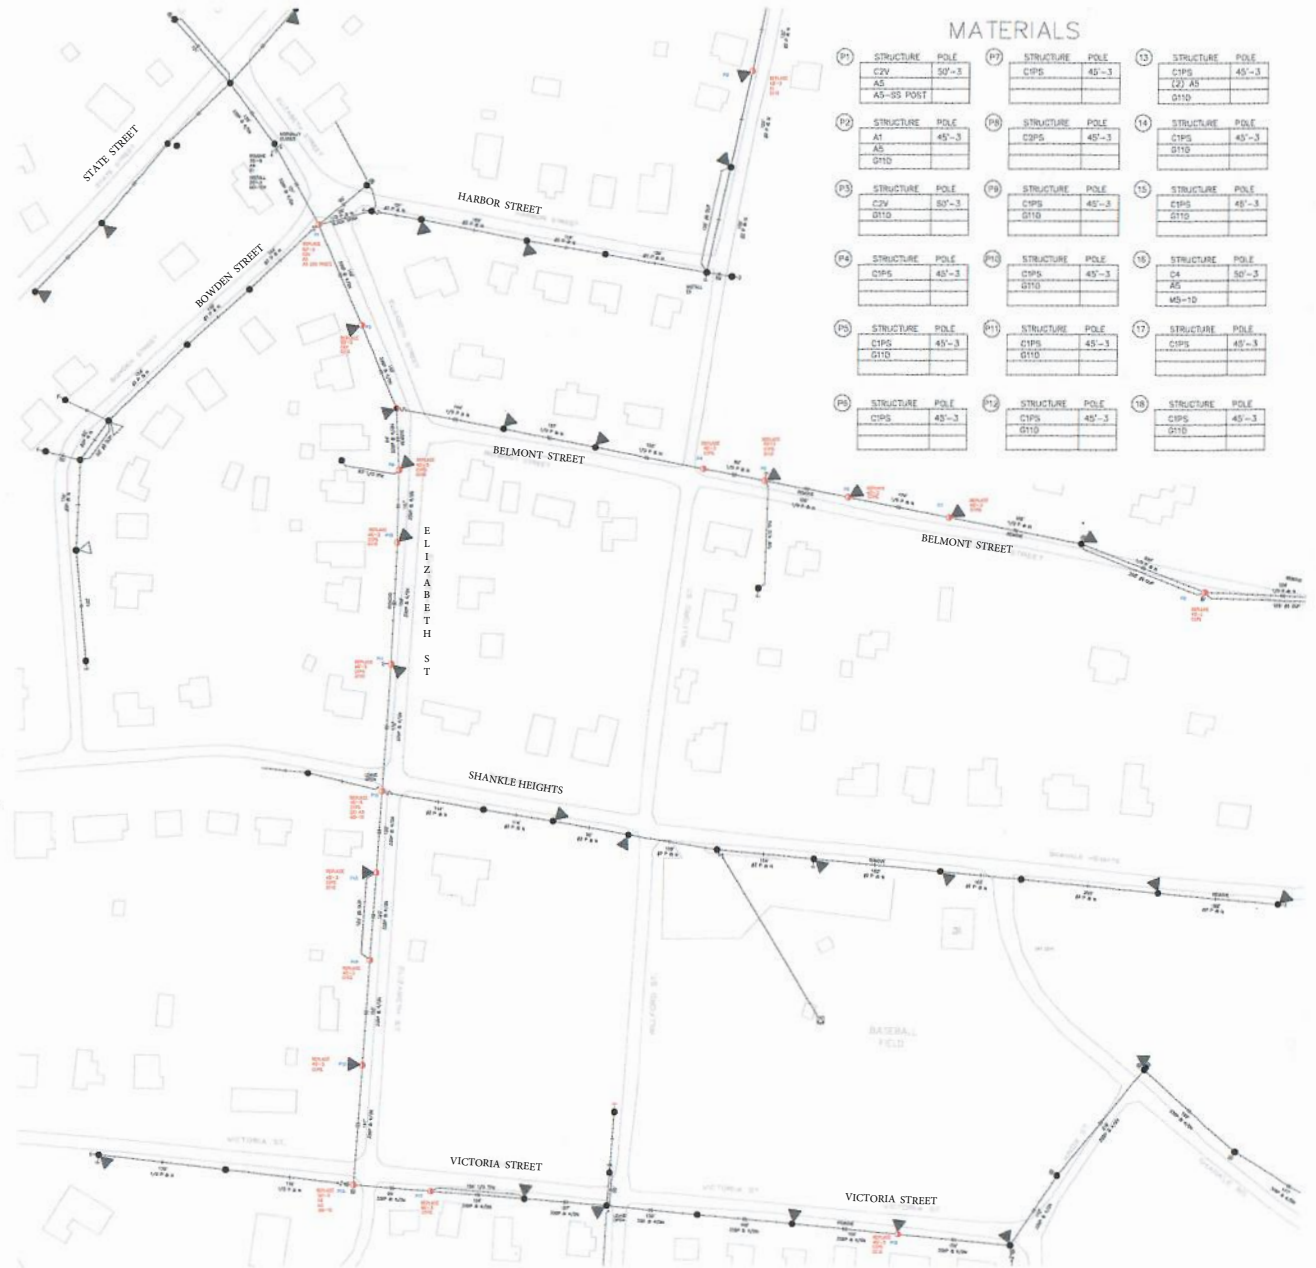

MATERIALS

P1	STRUCTURE POLE CVV AS AS-SS POST	50'-3"	P7	STRUCTURE POLE CIPS	45'-3"	P13	STRUCTURE POLE CIPS CJ AS G110	45'-3"
P2	STRUCTURE POLE A1 AS G110	45'-3"	P8	STRUCTURE POLE CIPS	45'-3"	P14	STRUCTURE POLE CIPS G110	45'-3"
P3	STRUCTURE POLE CVV G110	60'-3"	P9	STRUCTURE POLE CIPS G110	45'-3"	P15	STRUCTURE POLE CIPS G110	45'-3"
P4	STRUCTURE POLE CIPS	45'-3"	P10	STRUCTURE POLE CIPS G110	45'-3"	P16	STRUCTURE POLE C4 AS MS-10	50'-3"
P5	STRUCTURE POLE CIPS G110	45'-3"	P11	STRUCTURE POLE CIPS G110	45'-3"	P17	STRUCTURE POLE CIPS G110	45'-3"
P6	STRUCTURE POLE CIPS	45'-3"	P12	STRUCTURE POLE CIPS G110	45'-3"	P18	STRUCTURE POLE CIPS G110	45'-3"