



NOTE:

1. REFER TO VILLAGE STANDARD SPECIFICATIONS FOR STORM SEWER

HDPE TO RCP PIPE CONNECTIONS SHALL BE MADE WITH A MANHOLE UNLESS A COLLARED CONNECTION AS SHOWN IN THIS DETAIL IS APPROVED BY THE VILLAGE ENGINEER

HDPE PIPE TO BE CONNECTED

EXISTING GRADE

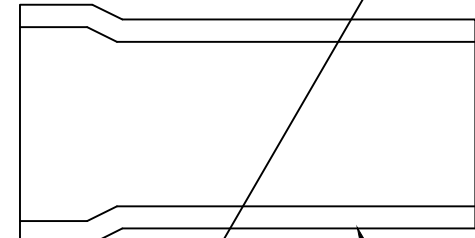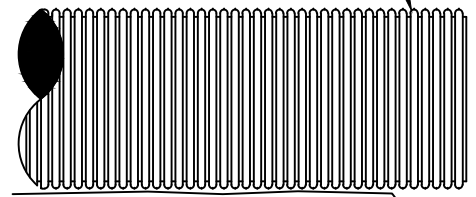

EXCAVATE EXISTING GRADE TO AVOID SOIL INTRUSION & TO CREATE SAFE WORK AREA

EXISTING RCP PIPE


NON-WOVEN GEOTEXTILE BE WRAPPED AROUND CONNECTION

NON-WOVEN GEOTEXTILE BE WRAPPED AROUND CONNECTION

FINISH GRADE

CAST IN PLACE CONCRETE ENCASEMENT


CAST IN PLACE CONCRETE ENCASEMENT

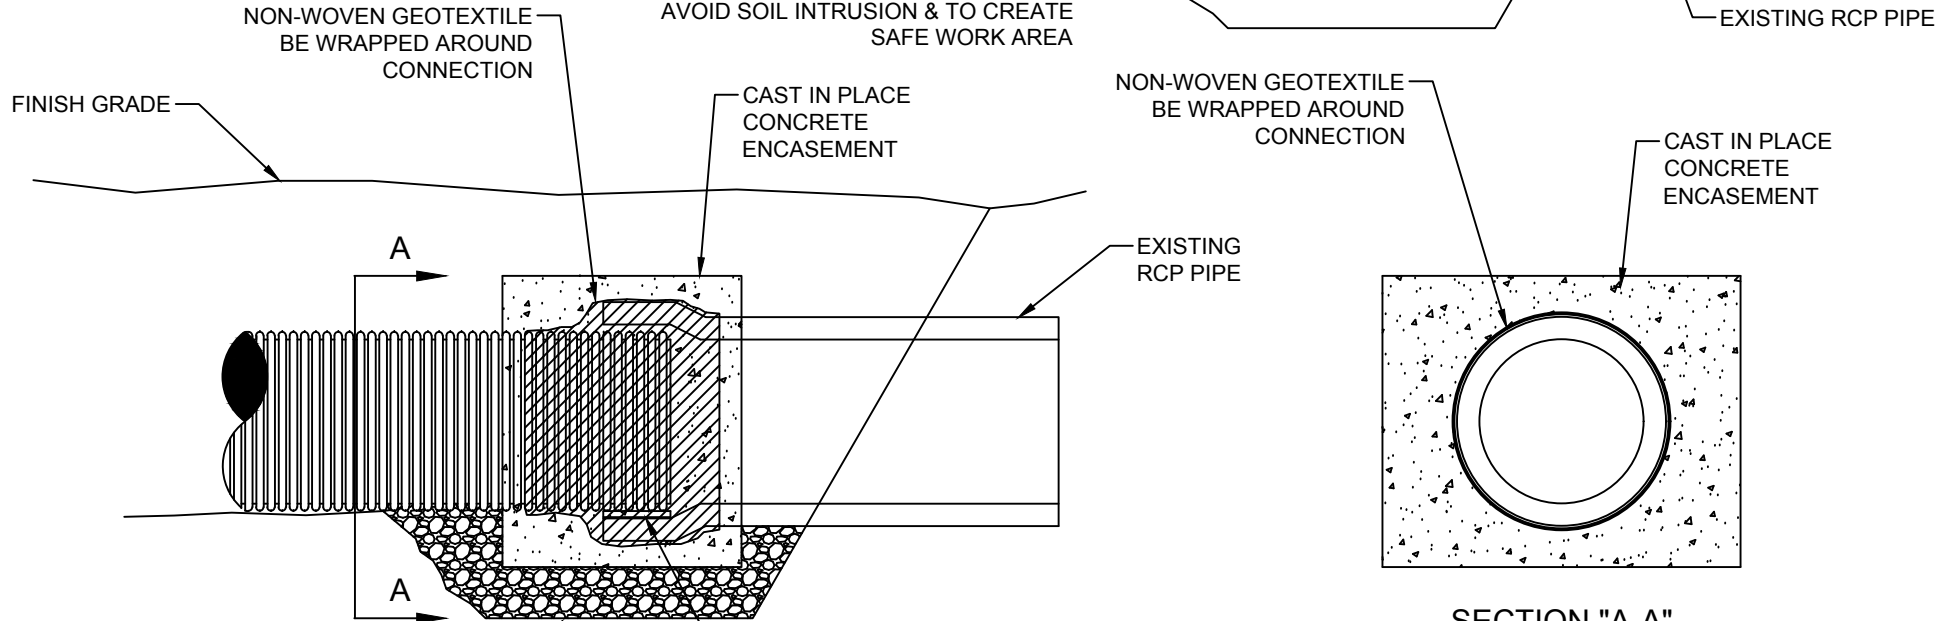

EXISTING RCP PIPE

BEDDING TO SUPPORT CONCRETE COLLAR

PROVIDE SPACER TO MATCH INVERTS AS NECESSARY

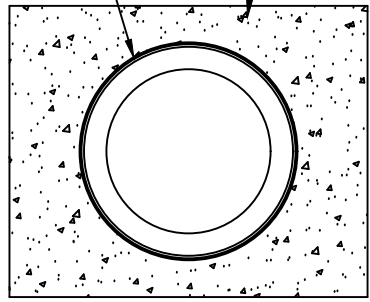

SECTION "A-A"

SCALE: NTS

HDPE TO RCP (BELLED END) CONNECTION DETAIL

DETAIL: STM - 7

DATE: 6-23-17

APPROVED BY: MATT FINEOUR

VILLAGE OF PLEASANT PRAIRIE
KENOSHA COUNTY, WISCONSIN