


PLAN VIEW

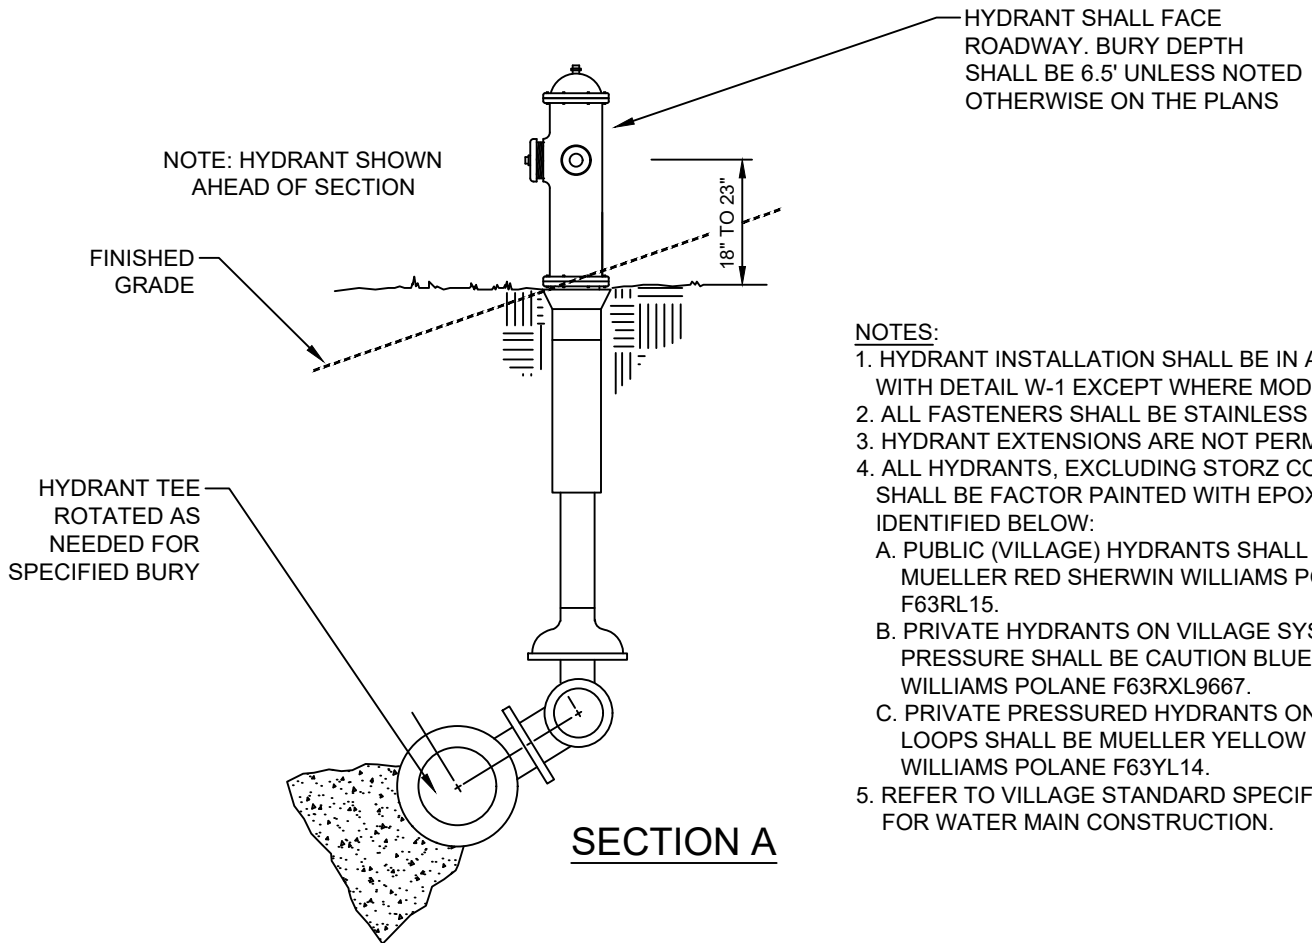

- NOTES:**
1. HYDRANT INSTALLATION SHALL BE IN ACCORDANCE WITH DETAIL W-1 EXCEPT WHERE MODIFIED.
 2. ALL FASTENERS SHALL BE STAINLESS STEEL.
 3. HYDRANT EXTENSIONS ARE NOT PERMITTED.
 4. ALL HYDRANTS, EXCLUDING STORZ CONNECTION, SHALL BE FACTOR PAINTED WITH EPOXY AS IDENTIFIED BELOW:
 - A. PUBLIC (VILLAGE) HYDRANTS SHALL BE MUELLER RED SHERWIN WILLIAMS POLANE F63RL15.
 - B. PRIVATE HYDRANTS ON VILLAGE SYSTEM PRESSURE SHALL BE CAUTION BLUE SHERWIN WILLIAMS POLANE F63RXL9667.
 - C. PRIVATE PRESSURED HYDRANTS ON FIRE LOOPS SHALL BE MUELLER YELLOW SHERWIN WILLIAMS POLANE F63YL14.
 5. REFER TO VILLAGE STANDARD SPECIFICATIONS FOR WATER MAIN CONSTRUCTION.

HYDRANT PARALLEL TO MAIN DETAIL

DETAIL: W - 7

DATE: 1-23-20

APPROVED BY: MATT FINEOUR

VILLAGE OF PLEASANT PRAIRIE
KENOSHA COUNTY, WISCONSIN